



KGB600 Glutathione Retension

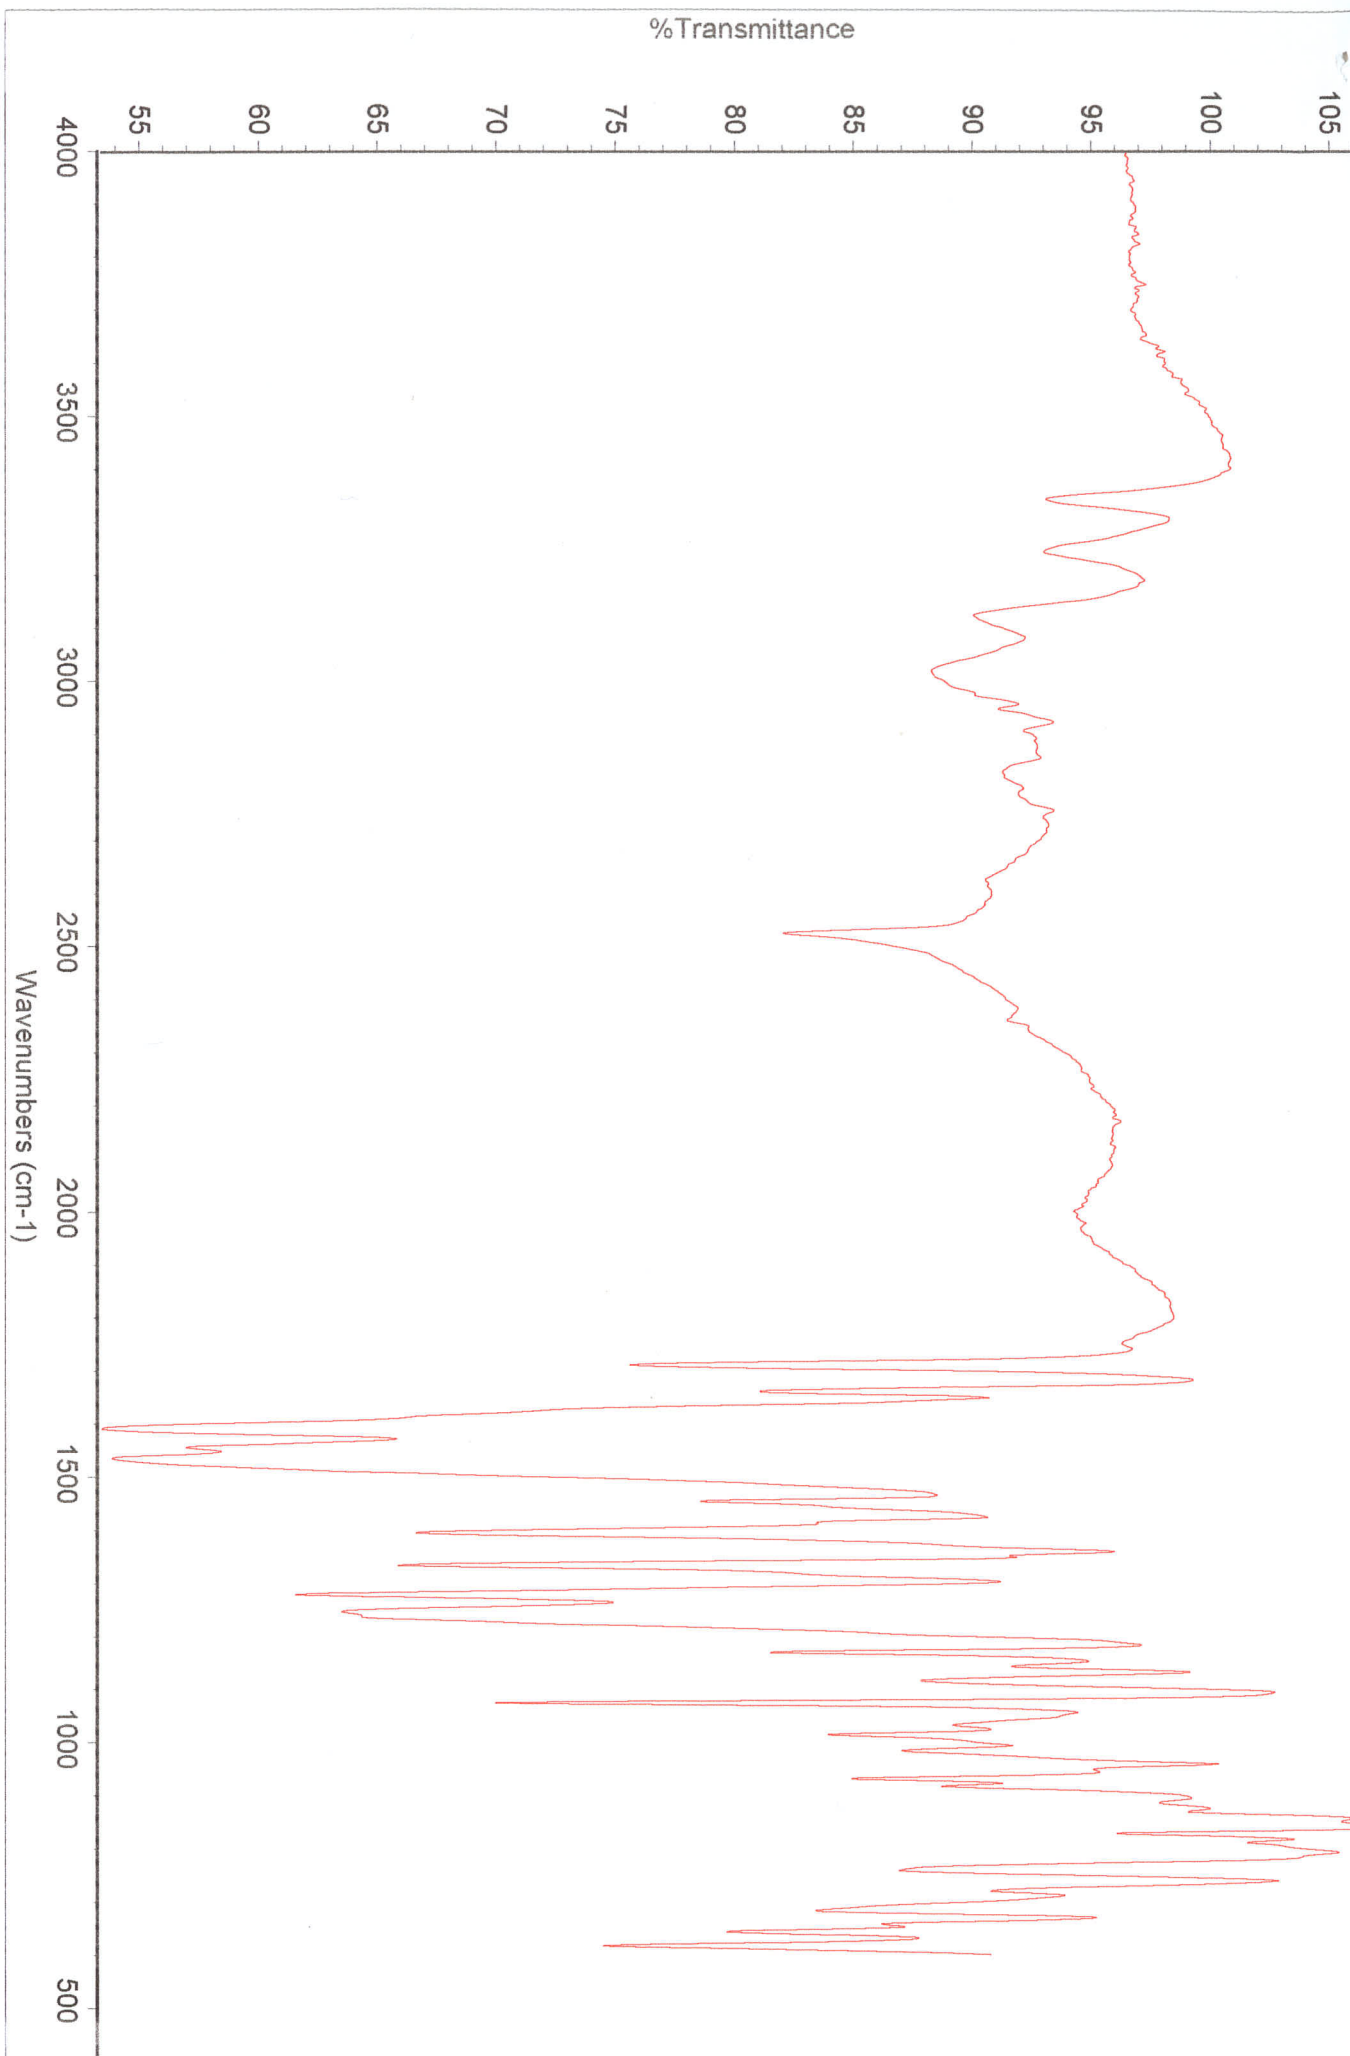

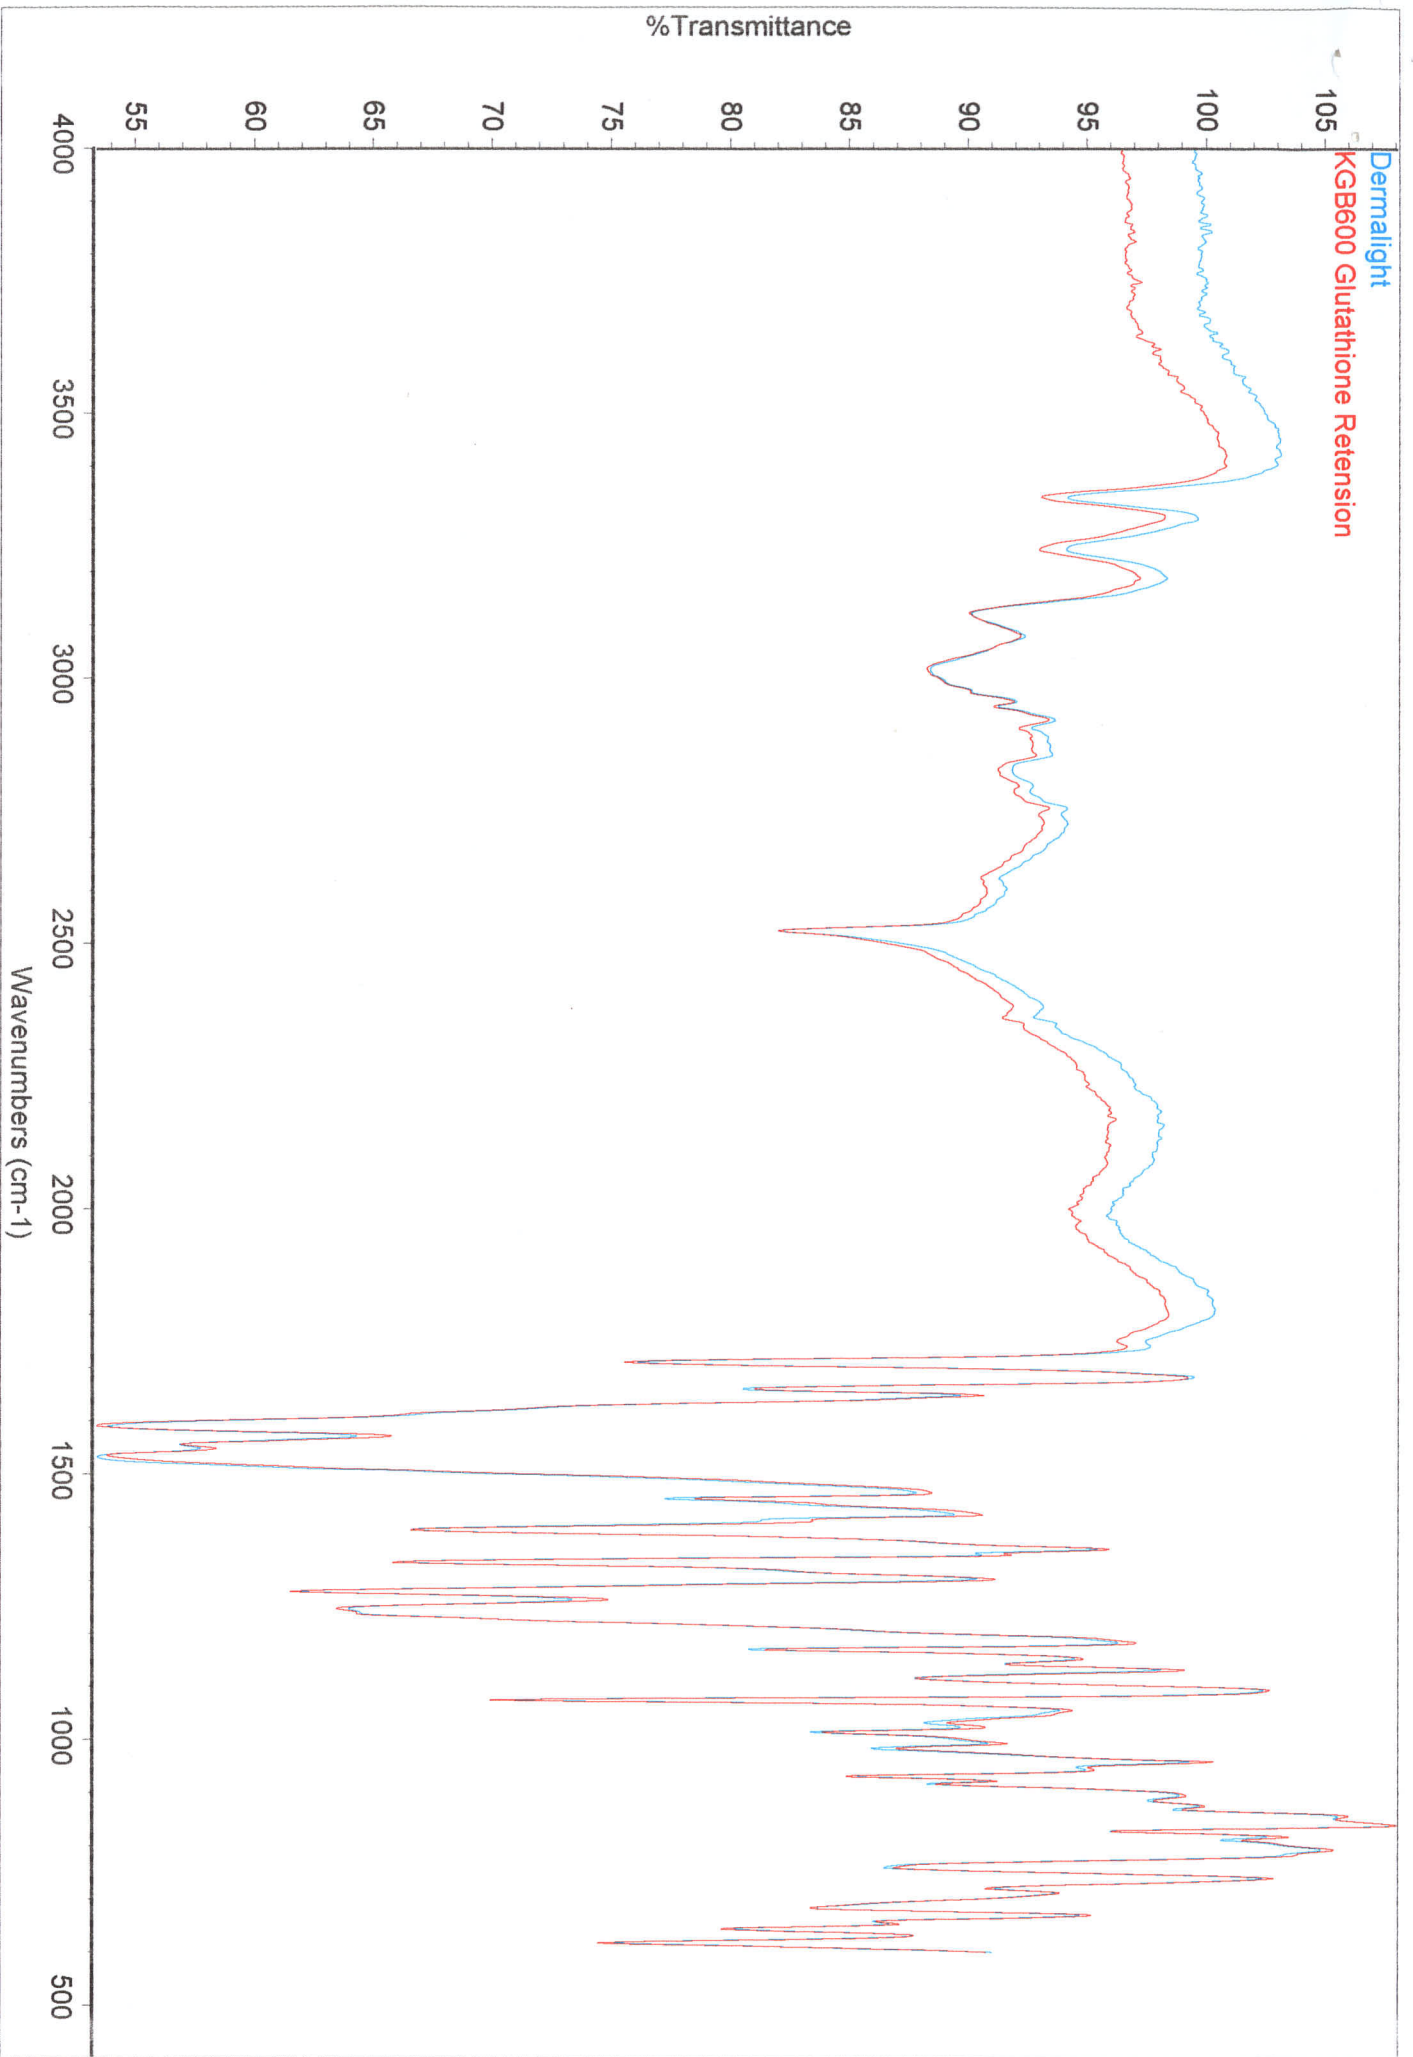

**SAMPLE REPORT**  
**CONSULTING CHEMICAL LABORATORIES (PTY) LTD**

P.O. Box 4936 ATLASVILLE 1465  
TEL: +27 11 395 3222 FAX: +27 11 395-2035

ASHLEY HARIPERSAD  
GLUTATHIONE SOUTH AFRICA  
P.O. BOX 2866  
FAERIEGLEN  
PRETORIA  
0043

TEL: 0846986160  
FAX:

Page no: 1 of 1  
Order no: ASHLEY  
Invoice no: 94136

Email: ashleyharipersad@gmail.com  
cc:

DATE RECEIVED: 27/01/2017  
BATCH: GLU6001 (NO EXP)  
SAMPLE NO: 17 01 631  
SAMPLE: DERMALIGHT

DATE TESTED: 27/01/2017

TEST	METHOD	LIMITS	RESULT
INFRA RED		COMPARES TO STANDARD	POSITIVE

**COMMENTS:**

REPORTED BY:

  
A da Luz

DATE: 27/01/2017

DIRECTOR: V. G. KOTERBA QA MANAGER: S. E. KING SUPERVISOR: B.G. BOTHA TECH MANAGER: A DA LUZ LAB MANAGER: D ELLETT

THE ABOVE RESULTS REFLECTS THE ANALYSIS ONLY OF THE SAMPLE, IN ITS CONDITION RECEIVED, AND ANALYSED IN TERMS OF YOUR INSTRUCTIONS. THIS REPORT MAY NOT BE REPRODUCED EXCEPT IN FULL AND WITHOUT THE WRITTEN PERMISSION OF THE DIRECTORATE. THE ABOVE PRODUCT HAS BEEN TESTED IN ACCORDANCE WITH TESTING INSTRUCTIONS, TESTING STANDARDS AND GLP.

FORM: 14A